


**NOTE**

A fully automatic fire alarm system is fitted to the whole of the function area in accordance with BS 5839-1:2002. Emergency lighting is installed to the whole of the building in accordance with BS 5266-1:2005

▣ 13A electrical outlets

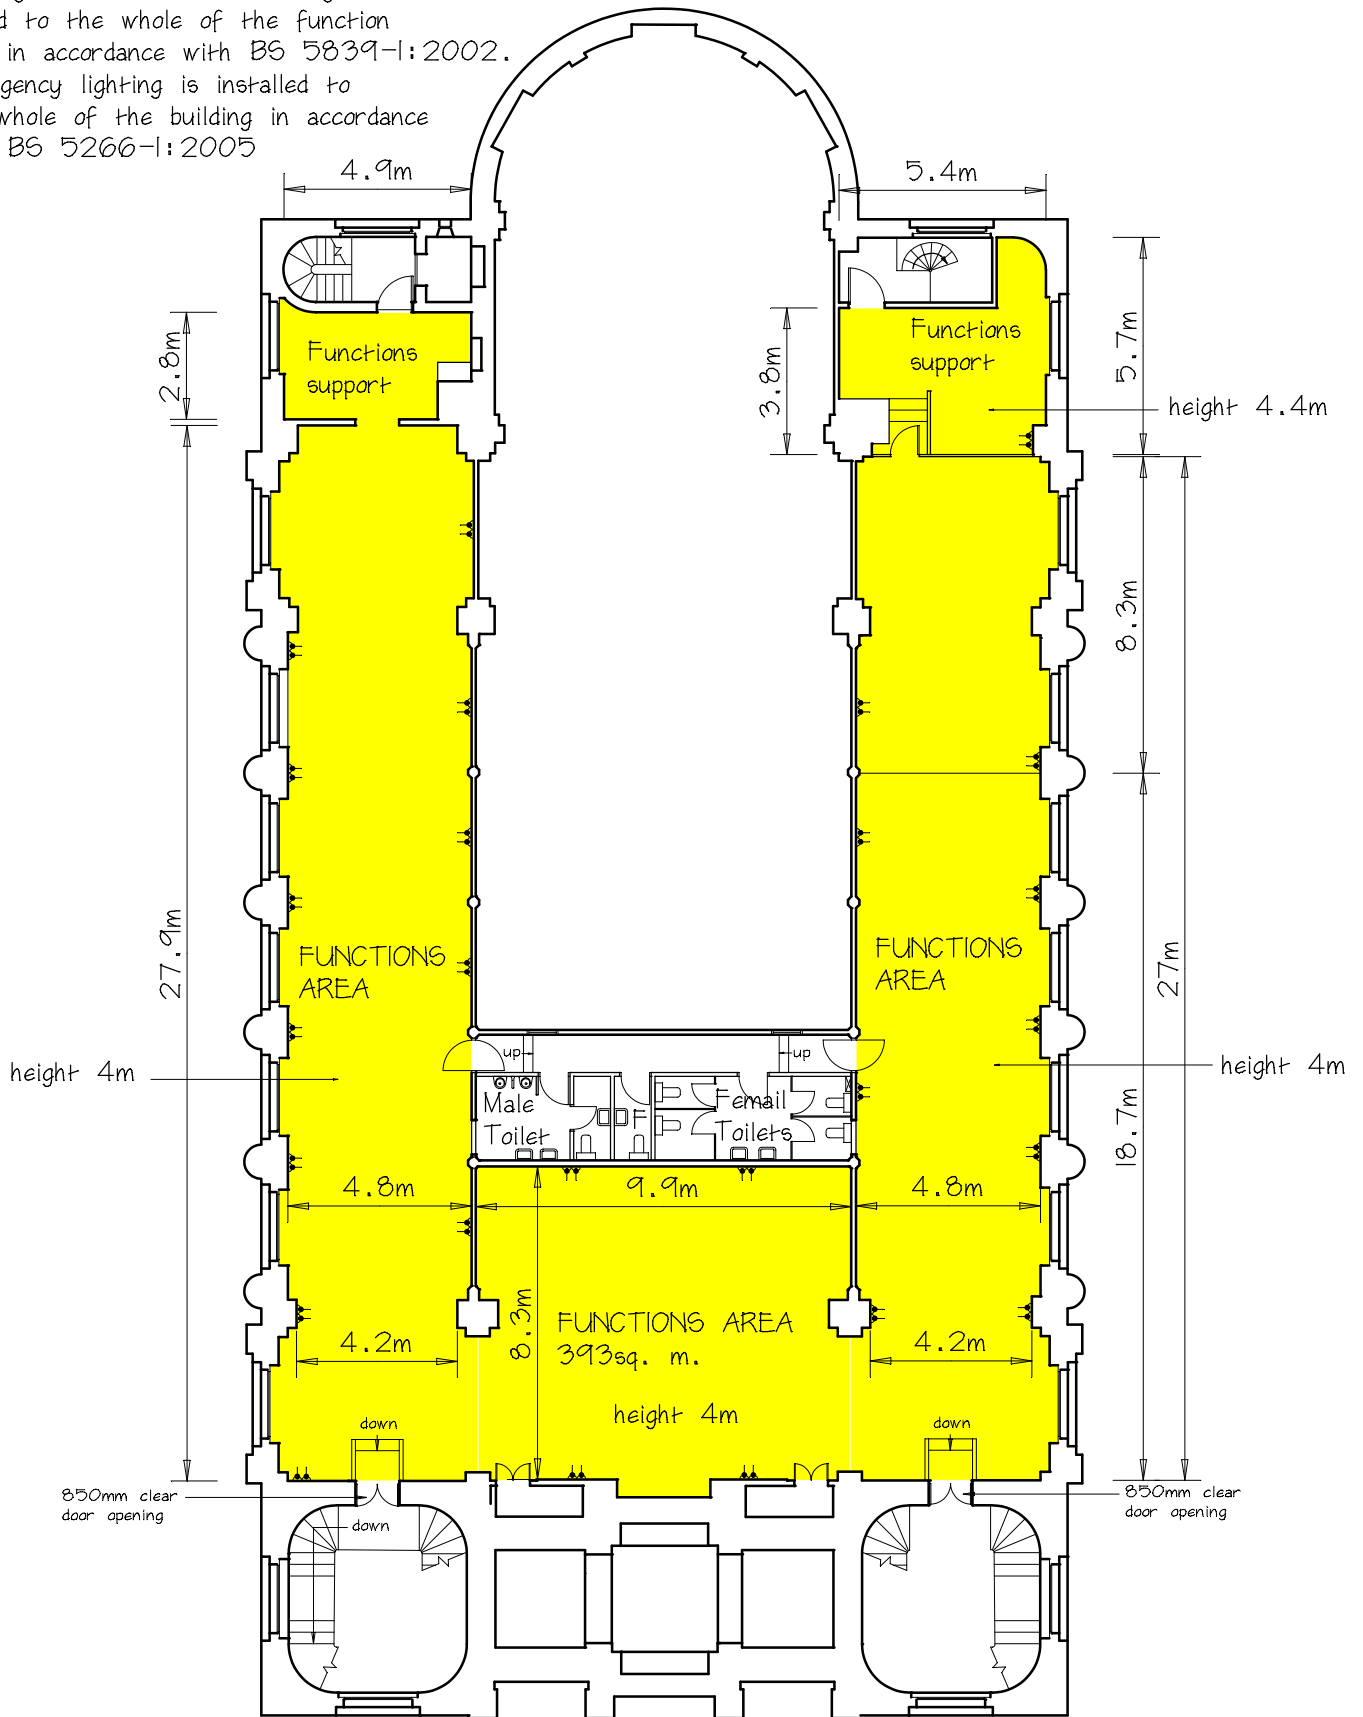

First Floor Plan

**PETER KNIGHT M.C.I.A.T., A.B.Eng., M.R.S.H.**

**CHARTERED ARCHITECTURAL TECHNOLOGIST**

The White Lodge Orange Tree Hill Havering-Atte-Bower Essex RM4 1PJ

Tel 01708 727955 Fax 01708 727955 Email peter@lrhak.freemove.co.uk

**PROJECT**

Holy Trinity Church  
1 Marylebone Road, Marylebone, London

**SCALE**

1-200

**DATE**

Feb. 09

**JOB No.**

106

**DRG.No.**

184

**REV**

A